

## Lead Paint Remediation Sales Lead Form

Project Information	
Project Number	1258
Site Name	
Site Address	1210 11th Ave, Neptune, NJ, 07753
Client Name	611 Asbury Inc
Client Contact	Antonio Pragosa
Client Phone Number	732-829-6868
Client Email	Asburyinc1@yahoo.com
Inspector:	Alex Salvador

To be filled out by Inspector
<p><input checked="" type="checkbox"/> No lead paint found.</p> <p><input type="checkbox"/> Lead paint found but remediation <u>NOT</u> recommended.</p> <p><input type="checkbox"/> Lead paint found and recommended remediation.</p>

To be filled out by Administration
Date Report was Mailed: _____
Mailed via:
<input type="checkbox"/> USPS 1 <sup>st</sup> Class <input type="checkbox"/> FedEx 2 Day <input type="checkbox"/> FedEx Overnight



181 US Hwy 46  
Mine Hill, NJ 07803  
(908) 654-8068  
(800) 783-0567  
Fax 908-654-8069

## LEAD-BASED PAINT EVALUATION REPORT INSPECTION

**Performed At:**

1210 11th Avenue  
Neptune, NJ, 07753

**Performed For:**

611 Asbury Inc  
Antonio Pragosa  
17 Heidl Ave, West Long Branch, NJ, 07764

**Prepared By:**

LEW Environmental Services, LLC.  
181 US Hwy 46  
Mine Hill, NJ 07803

Phone (908) 654-8068

Fax (908) 654-8069

Inspection Date: 01/09/2024

Project Number: 1258

# **Table of Contents**

<b>CONTACT INFORMATION .....</b>	<b>3</b>
<b>EXECUTIVE SUMMARY .....</b>	<b>4</b>
HOUSE INTERIOR COMPONENTS WITH LEAD BASED PAINT .....	4
EXTERIOR COMPONENTS WITH LEAD BASED PAINT .....	4
PAINT CHIPS (IF APPLICABLE).....	4
<b>REGULATORY REQUIREMENTS.....</b>	<b>5</b>
REQUIRED DISCLOSURE .....	5
REQUIRED TRAINING FOR WORKERS .....	5
<b>CONTROLLING LEAD-BASED PAINT.....</b>	<b>5</b>
ABATEMENT FOR LEAD-BASED PAINT FREE CERTIFICATION .....	6
ABATEMENT TO CONTROL LEAD-BASED PAINT HAZARDS.....	6
INTERIM CONTROL OPTIONS .....	7
<b>PROCEDURES &amp; METHODOLOGY .....</b>	<b>7</b>
LOCATION CONVENTIONS .....	7
PAINT TESTING.....	7

# **Appendices**

APPENDIX A	FLOOR PLAN
APPENDIX B	LEAD-BASED PAINT EVALUATION REPORT
APPENDIX C	PHOTOGRAPHS (IF APPLICABLE)
APPENDIX D	LAB SUPPORT DOCUMENTS (IF APPLICABLE)

## Contact Information

### Site

Name	N/A
Street Address	1210 11th Ave, Neptune, NJ, 07753

### Client

Name	611 Asbury Inc
Contact	Antonio Pragosa
Street	17 Heidl Ave, West Long Branch, NJ, 07764
Phone Number	732-829-6868

### Site Evaluator

Site Evaluator	Alex Salvador
Certification Number	NJDHSS 022779
Instrumentation	Viken Pb200e Serial #2825
Signature	<i>Alex Salvador</i>
Date	January 19, 2024

### Firm

Organization:	LEW Environmental Services, LLC.
Certification #:	NJDCA 00015
Street:	181 US Hwy 46
City, State & Zip:	Mine Hill, NJ 07803
Phone Number:	908-654-8068
Web Address:	www.lewcorp.com

## Executive Summary

On 01/09/2024 Alex Salvador, of LEW Environmental Services, LLC. performed a lead-based paint inspection at 1210 11th Ave, Neptune, NJ, 07753. House Interior. Of the 194 readings taken, 0 were positive for lead-based paint. The lead-based paint inspection sampling protocol that was applied follows "Inspections in Single-Family Housing" Chapter 7 of the HUD Guidelines (2012 revision) and the protocol as referenced in USEPA 40 CFR Part 745.227(b). See Appendix B Lead Paint Inspection Report for the complete set of X-Ray Fluorescence data.

The apartment unit A-Wall pertains to the wall that is in the same plane or closest to the street address of the property.

The tables below indicate the location of the lead-based paint found. Each positive reading applies to all similar components in the same room equivalent (room, hall, stairwell, building exterior, etc.) For a lead-based paint free certification, the lead must be stripped or the leaded component replaced and confirmation achieved. Enclosure and encapsulation are not acceptable methods for a lead-based paint free certification.

### House Interior Components with Lead Based Paint

Room Equivalent	Component	Substrate	Value(mg/cm <sup>2</sup> )
NONE			

### Exterior Components with Lead Based Paint

Room Equivalent	Component	Substrate	Value(mg/cm <sup>2</sup> )
NONE TESTED			

### Paint Chips (if applicable)

Sample number	Location	Measurement	Actionable
NONE COLLECTED			

EPA 40 CFR 745.227(h) states lead-based paint is present on any surface that is tested and found to contain lead equal to or in excess of 1.0 milligrams per square centimeter or equal to or in excess of 0.5% by weight. Local thresholds may be lower than this Federal standard. For example, NYC defines LBP as equal to or in excess of 0.5 milligrams per square centimeter

# Regulatory Requirements

## Required Disclosure

A summary of this lead-based paint evaluation report must be provided to new lessees (tenants). A complete copy of this report must be provided to purchasers and owners of this property and it must be made available to new tenants under federal law (24 CFR PART 35 AND 40 CFR PART 745) before they become obligated under a lease or sales contract. Landlords (lessors) and sellers are also required to distribute an educational pamphlet approved by the U.S. Environmental Protection Agency and include standard warning language in their leases or sales contracts to ensure that parents have the information they need to protect their children from lead-based paint hazards.”

Should the recipient of this report receive federal subsidy they are responsible to comply with all requirements of 24 CFR Part 35 Requirements for the Notification, Evaluation and Reduction of Lead-Based Paint Hazards in Federally Owned Residential Property and Housing Receiving Federal Assistance; Final Rule which, are applicable to the type of program they are participating in and the dollar amount of subsidy being received. If this property or any of its tenants receives financial federal assistance, the results of the evaluation or hazard reduction activities must be provided by the designated party (client) to the owner of the referenced property and the occupants within 15 calendar days of the date when the designated party receives this report, or makes the presumption that lead-based paint hazards do exist.

## Required Training for Workers

Should the lead-based paint and lead hazard reduction activities be part of a program which receives federal subsidy or a New Jersey multifamily building, all persons performing “Interim Controls” or “Standard Treatments” must be trained in accordance with 29 CFR 1926.59 and be supervised by an individual who successfully completed one of the following courses:

1. A lead-based paint abatement supervisors course accredited in accordance with 40 CFR 745.225
2. A lead-based paint abatement worker course accredited in accordance with 40 CFR 745.225
3. The lead-based paint Maintenance Training Program, “Work Smart, Work Wet, and Work Clean to Work Lead Safe”, prepared by the National Environmental Training Association for EPA and HUD
4. “The Remodeler’s and Renovator’s Lead-Based Paint Training Program,” prepared by HUD and the National Association of the Remodeling Industry
5. Another course approved by HUD for this purpose after consultation with EPA.

In accordance with Section 35.1340 all Lead-Based Paint and Lead Hazard reduction activities, which are not exempt (see regulations) require Lead Dust Wipe Clearance testing by a 1) certified lead inspector, 2) certified risk assessor or 3) a dust wipe sampling technician whose work is reviewed by a certified risk assessor.

If a renovation at the property is to occur, all work should comply with 40 CFR 745 Subpart E-Residential Property Renovation.

## Controlling Lead-Based Paint

There are different options available for controlling lead-based paint. Each option has its own associated costs and benefits both short and long term. In most cases, a combination of the options can be implemented to reduce the possibility of lead contamination. LEW Environmental Services, LLC. strongly suggests that each option is thoroughly contemplated before beginning any activity.

Components that are found to be positive for lead-based paint should be checked for deterioration. Lead-based paint in deteriorated condition is considered a paint-lead hazard. Those components should be address as soon as possible using lead safe work practices at a minimum. However, if any components are found to test positive for lead based paint, they should be considered for future component removal or paint stripping.

## ***Abatement for Lead-Based Paint Free Certification***

### **Component Removal**

Component removal is a permanent solution to the issue of potential exposure of lead. It requires taking the old lead-based painted component out and replacing it with a new non-lead painted component. The cost associated with this option depends mostly on the cost of the replacement component. Since labor is most often the more costly aspect of controlling lead issues, many owners choose component removal over more labor intensive methods. Components often chosen for removal are wood trim, windows, most doors, and exterior railings. Plaster and drywall ceilings and walls, fire rated doors, and wood porch components should also be considered.

### **Paint Stripping**

Paint stripping is a permanent solution to the issue of potential exposure of lead. The paint can be removed either in-place or by an off-site processing facility. In-place removal can be mechanical or chemical. In-place paint stripping has the issue of proper disposal of the hazardous waste generated.

Mechanical stripping scrapes the paint off the substrate. Most times dry scraping is prohibited, but sanding or scraping can be done in conjunction with engineering controls to reduce airborne and settled lead dust. Power tools used to remove the paint must be equipped with a HEPA filtered shroud. Wetting a surface and hand scraping is also permitted. The components most often chosen for hand scraping are window and door jambs. Power tools are better equipped to handle larger surface areas.

Chemical stripping in-place uses strong chemicals to soften the paint for easier removal from the substrate. The chemicals are either very acidic or very basic, so proper training and protection for the worker is imperative. Generally, the chemicals must remain in-place overnight, so maintaining a secure worksite separate from occupants is mandatory.

Off site facilities use much stronger chemicals to remove the lead-based paint from the component. Components often chosen for off-site paint removal are intricate metal pieces. Sometimes this method is used for intricate wood work, but the stronger chemicals soften the wood and can drive lead into the wood while removing the paint.

## ***Abatement to Control Lead-Based Paint Hazards***

### **Enclosure**

Enclosure is the option of sealing off the lead-based painted component by sealing it in with another building material. Such materials would include, but are not limited to; sheet rock, paneling, vinyl or aluminum siding and radiator covers, etc. Enclosure is not a permanent solution; and, if the enclosure material ever becomes disturbed, the lead-based paint is exposed. Depending on the building material used for enclosure, this can be an affordable option. Depending on the enclosure option taken it is possible that no lead abatement procedures need to be followed; but, of course, consult a professional before beginning.

### **Encapsulation**

Encapsulation is the process of using an encapsulant-type of product that is applied over the lead-painted component. There are currently many different types of encapsulants on the market, and they come in many different forms. Some encapsulants are like stucco, some are like a two-part epoxy, some are like a heavy latex paint, and some are like a cement or plaster. Different types of encapsulants have different life expectancies and some come in different colors. None of the encapsulants are guaranteed forever, although some do come with a life or 10 to 20 year guarantee. To be considered a true lead abatement method according to the American Society of Testing Materials (ASTM) the encapsulant must meet their longevity criteria of at a minimum twenty (20) years. This option is not a permanent solution; and if the encapsulant ever becomes disturbed, the lead-based paint is exposed. Encapsulation is typically the least expensive option and has currently been accepted at the federal level as a viable and affordable option for lead abatement or in-place management, assuming the encapsulant meets the ASTM requirements for encapsulants.

## ***Interim Control Options***

An In-Place Management program is an on going set of measures designed to temporarily reduce human exposure or possible exposure and accessibility to lead-based paint hazards. Such measures include specialized cleaning, repairs, maintenance, paint stabilization, painting, temporary containment, and management and resident education programs. Monitoring, conducted by owners, and reevaluations conducted by professionals, are integral elements of interim controls. Interim controls include dust removal; paint film stabilization; treatment of friction and impact surfaces; installation of soil coverings, such as grass or sod; ground covering plants so as not to allow for easy accessibility, and land-use controls

Unlike Abatement, Interim Controls are considered to be temporary repairs and are not to be used as permanent solutions to lead-based hazards. Interim controls strategies are a very effective and cost saving program to substantially reduce the potential for lead poisoning. However, interim controls programs will only work and prove effective if reevaluation is continually performed. Reevaluation is the combination of a visual assessment and collection of environmental samples by a certified risk assessor on an on-going basis to determine if a previously implemented lead-based hazard control measure is still effective and if the dwelling remains lead-safe.

LEW Environmental Services, LLC. strongly suggests that HEPA vacuuming and Lead-Specific Cleaning detergent/LEDIZOLV wash downs should continue on a routine basis and a continual visual inspection/assessment and sample collection should be performed at least every 1 to 3 years, or until the dust levels continually remain below actionable levels.

## **Procedures & Methodology**

### ***Location Conventions***

When reviewing Appendix A "Floor Plan" and Appendix B "Lead-Based Paint Evaluation Report", you will notice that the letters A, B, C, and D are used to identify the location of specific components. The key to correct orientation is the location of the "A" wall, which is depicted on the floor plan or in the Executive Summary. The "B" wall, "C" wall, and "D" wall run clockwise from the "A" wall. The Lead-Based Paint Evaluation Report lists this information under the "Wall" column. The "Location" column uses numbering of replicated components starting with "1" at left and continuing sequentially to right respectively to describe the location of the component while facing the wall identified.

### ***Paint Testing***

#### **X-Ray Fluorescence**

X-Ray Fluorescence (XRF) paint testing is performed to detect the presence of lead on painted surfaces. The XRF instrument is state-of-the art equipment. XRF testing is usually the preferred method of testing, because it is non-destructive, quantitative and can be performed on the spot with acceptable accuracy. LEW Environmental Services, LLC. 's evaluators follow the manufacturer's suggested use and the Performance Characteristic Sheet of the XRF instrument being used. The results of the XRF testing are the basis for drawing conclusions and making recommendations in the report.

All LEW Environmental Services, LLC. 's evaluators follow 40 CFR 745 and the HUD Guidelines for testing lead using an XRF instrument. All federal, state and city regulations are followed when applicable. The evaluator will test one of each and every different type of testing combination (component) in each room being surveyed. Each XRF reading is assigned an exclusive sample reference number and a measurement that is stored in the instrument. Each sample reference number location is logged on the XRF instrument for future reference, testing location, and report generation. The above described testing format is followed unless otherwise not practical or if the evaluator's judgment decides to test in a different systematic approach.

It should be noted that detected lead levels below current levels still could create lead dust or lead-contaminated soil hazards if the paint is turned into dust by abrasion, scraping, or sanding leading to possible elevated blood lead levels. Lead poisoning is a cumulative affect. Should a child or an adult inhale or ingest sufficient quantities of low



concentrations of leaded paint, dust, or soil, it will accumulate in the body's systems and could eventually cumulate to an elevated blood level of concern.

**Any untested building components should be considered lead-based paint until tested.**

## **Substrate Correction**

X-Ray Fluorescence (XRF) readings are sometimes subject to systematic biases as a result of interference from substrate material beneath the paint. The magnitude and direction of bias depends on the substrate, the specific XRF instrument being used, and other factors such as temperature and humidity. Results can be biased in either the positive or negative direction and may be quite high. Consequently, the XRF Performance Characteristic Sheet is consulted to determine the requirements for XRF substrate correction conditions.

XRF results are corrected for substrate bias by subtracting a correction value determined by randomly selecting two housing units to be used to collect substrate measurements for all substrates within the development that need corrections and use the results from those two units to perform substrate correction calculations in all tested units within the development or building. The substrate correction value is obtained by using the specific XRF instrument(s) that is/are being used at the site. The correction value is an average of six XRF readings taken over red NIST SRM (1.02mg/cm<sup>2</sup>) paint film, with three readings taken from two test locations that have been scraped visually clean of their paint coating. The red NIST SRM 1.02mg/cm<sup>2</sup> is then subtracted from the average of the six readings; the result is the Substrate Correction value. The substrate correction value is then subtracted from the XRF measurement on the specific testing combinations that falls within the substrate correction range according to the Performance Characteristic Sheets requirements. According to the Performance Characteristic Sheet for the XRF instrument once a substrate correction value is applied should it be needed the final Lead-Based Paint measurement should be either Positive or Negative.

## **Calibration Check Readings**

In addition to the manufacturer's recommended warm up and quality control procedures, LEW Environmental Services, LLC. collects quality control readings as recommended in the HUD Guidelines. Quality control for XRF instrumentation instruments involves readings to check calibration.

For each XRF instrument, one set of XRF calibration check readings are recommended at least every four hours. The first is a set of three nominal-time or source decay corrected time XRF calibration check readings to be taken before the inspection begins for the day. The second occurs either after the day's inspection work has been completed, or at least every four hours, whichever occurs first. LEW Environmental Services, LLC. 's XRF calibration check readings are taken on the Standard Reference Material (SRM) paint film nearest to 1.0 mg/cm<sup>2</sup> within the National Institute of Standards and Technology (NIST) SRM Used or the XRF manufacturer's factory supplied SRM film. Three readings are collected on the SRM. The average of the three readings on the SRM must be within the acceptable plus and minus tolerances for proper calibration as detailed in the Performance Characteristic Sheet (PCS). All calibration checks are taken with the SRM film positioned at least several inches away from any potential source of lead.

Three readings are taken each time calibration check readings are made, the readings are taken using the nominal time that is specified in the Performance Characteristic Sheet. The average of the readings are compared to the known value and if the average value is within the acceptable calibration check tolerance specified in the XRF Performance Characteristic Sheet the instrument is considered in control. If the average readings are not within the calibration check tolerance the instrument is not used until the instrument is brought back into control.

## **Paint Chips**

Paint chips are taken for confirmation of lead based paint, or as a solution to inconclusive measurement recorded by the use of XRF testing. Paint chips are typically not taken unless absolutely necessary. On components that are right on the XRF action level, a paint chip is the only other way to get a conclusive determination as to the level of lead in the paint and if the component should be considered as actionable or not. Paint chips, when taken, are usually taken from an inconspicuous areas and tape and/or paint is placed over the removed paint location.

When the inspector collects paint-chip samples for analysis, they are analyzed by a laboratory recognized under the EPA's National Lead Laboratory Accreditation Program (NLLAP). Paint-chip samples contain all layers of paint (not just

peeled layers) and must always include the bottom layer. If results will be reported in mg/cm<sup>2</sup>, including a small amount of substrate with the sample will not significantly bias results. Substrate material should not, however, be included in samples reported in weight percent. Paint from 4 square inches (25 square centimeters) should provide a sufficient quantity for laboratory analysis. Smaller surface areas may be used, if the laboratory indicates that a smaller sample is acceptable.


**Current action levels for lead in paint:**

PAINT CHIP ACTION LEVELS BY PERCENT WEIGHT	0.5% OR 5000 parts per million
PAINT CHIP ACTION LEVELS BY WEIGHT PER AREA	Same as XRF action levels, may be state dependent


Appendix A

Floor Plan


Site: 1210 11th Avenue Neptune NJ  
 1st floor

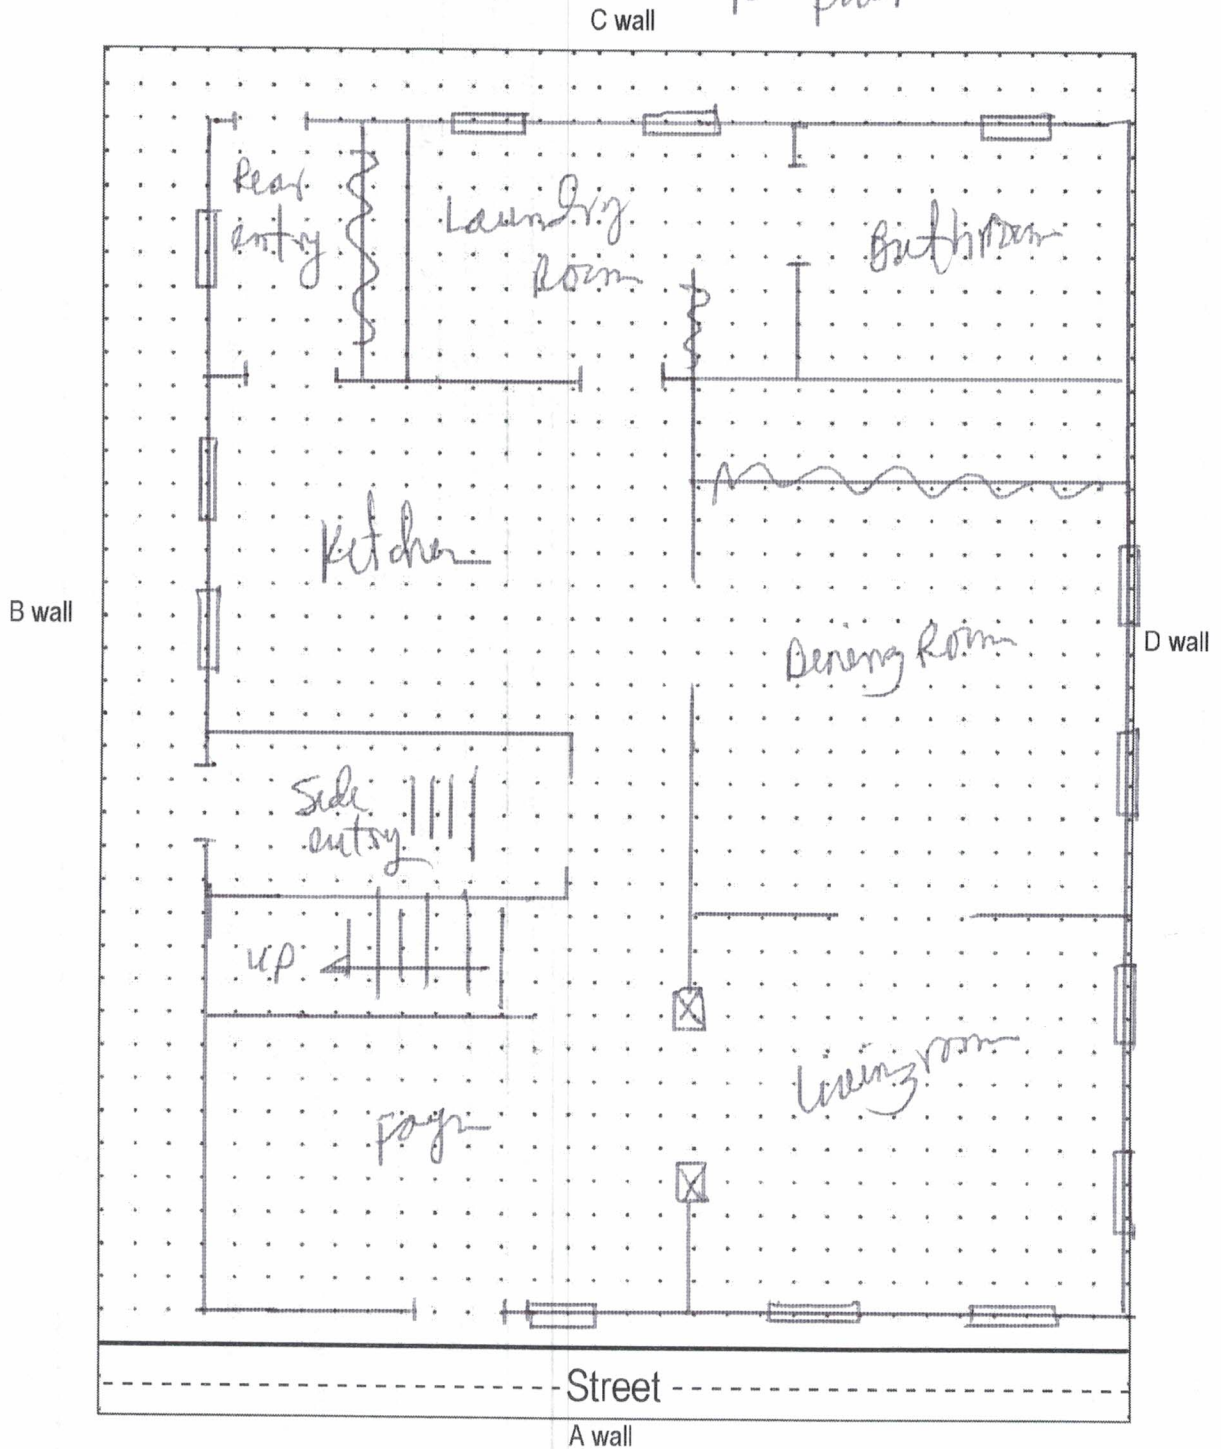

Site: 1210 11th Avenue Neptune NJ  
C wall 2nd floor

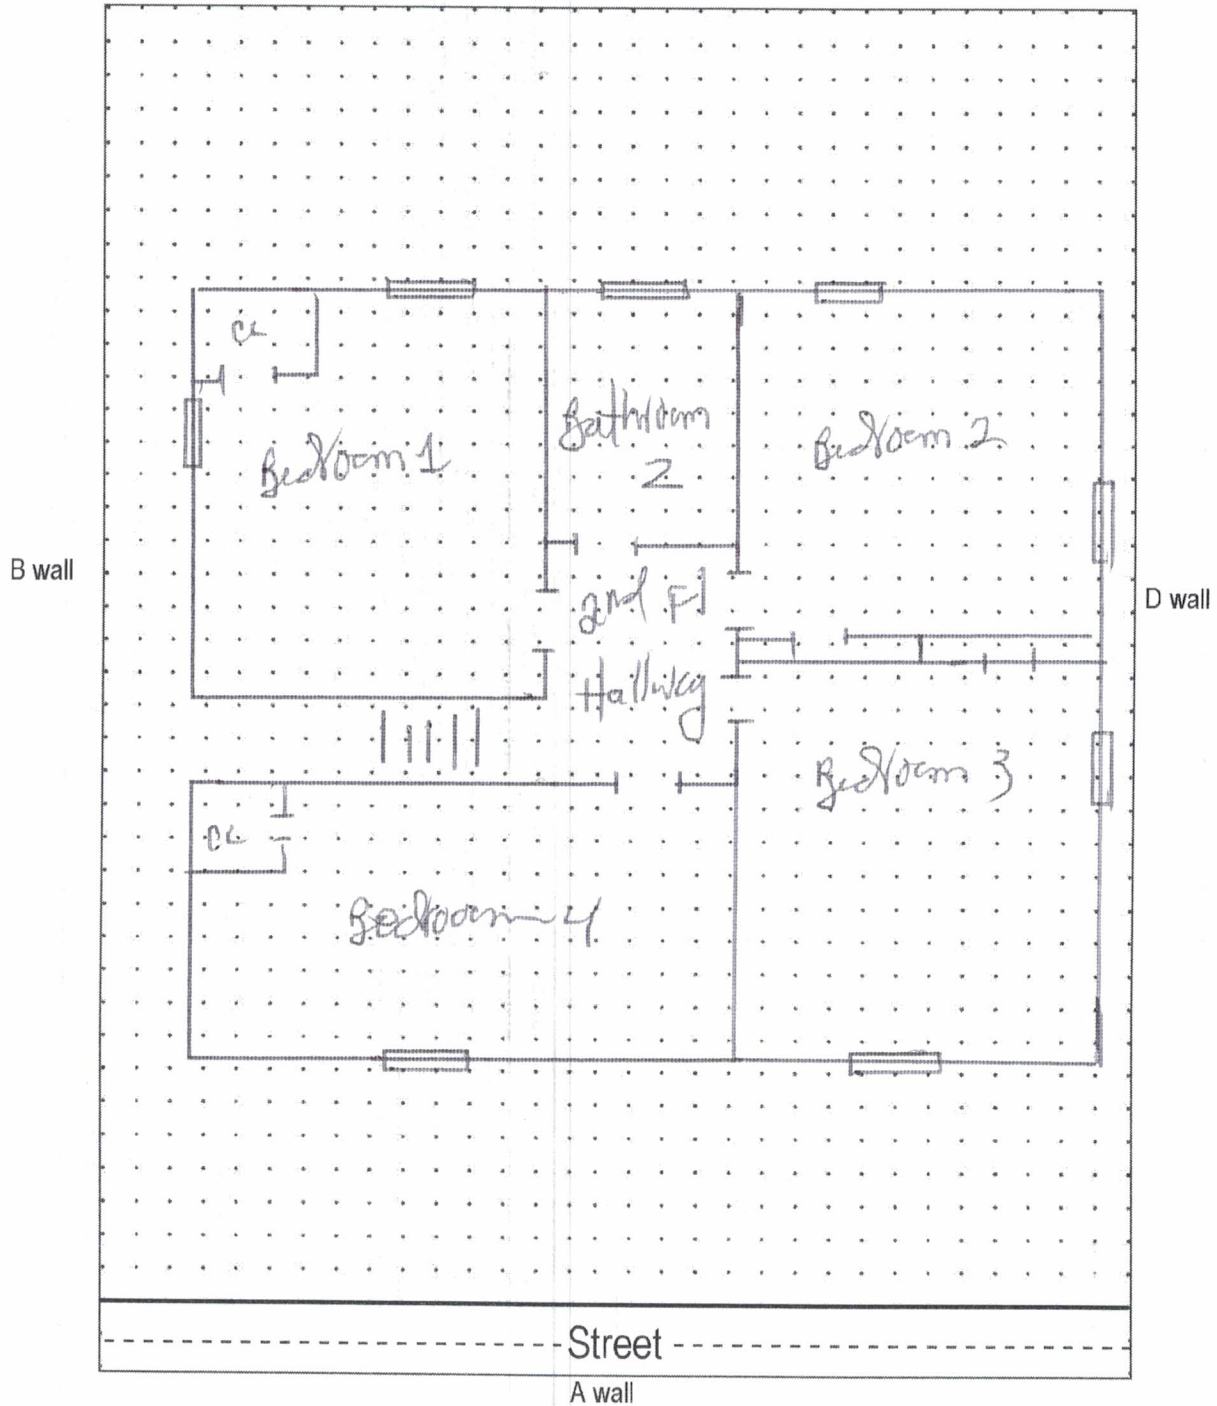

Site: 1210 11th Avenue Neptune NJ  
Attic

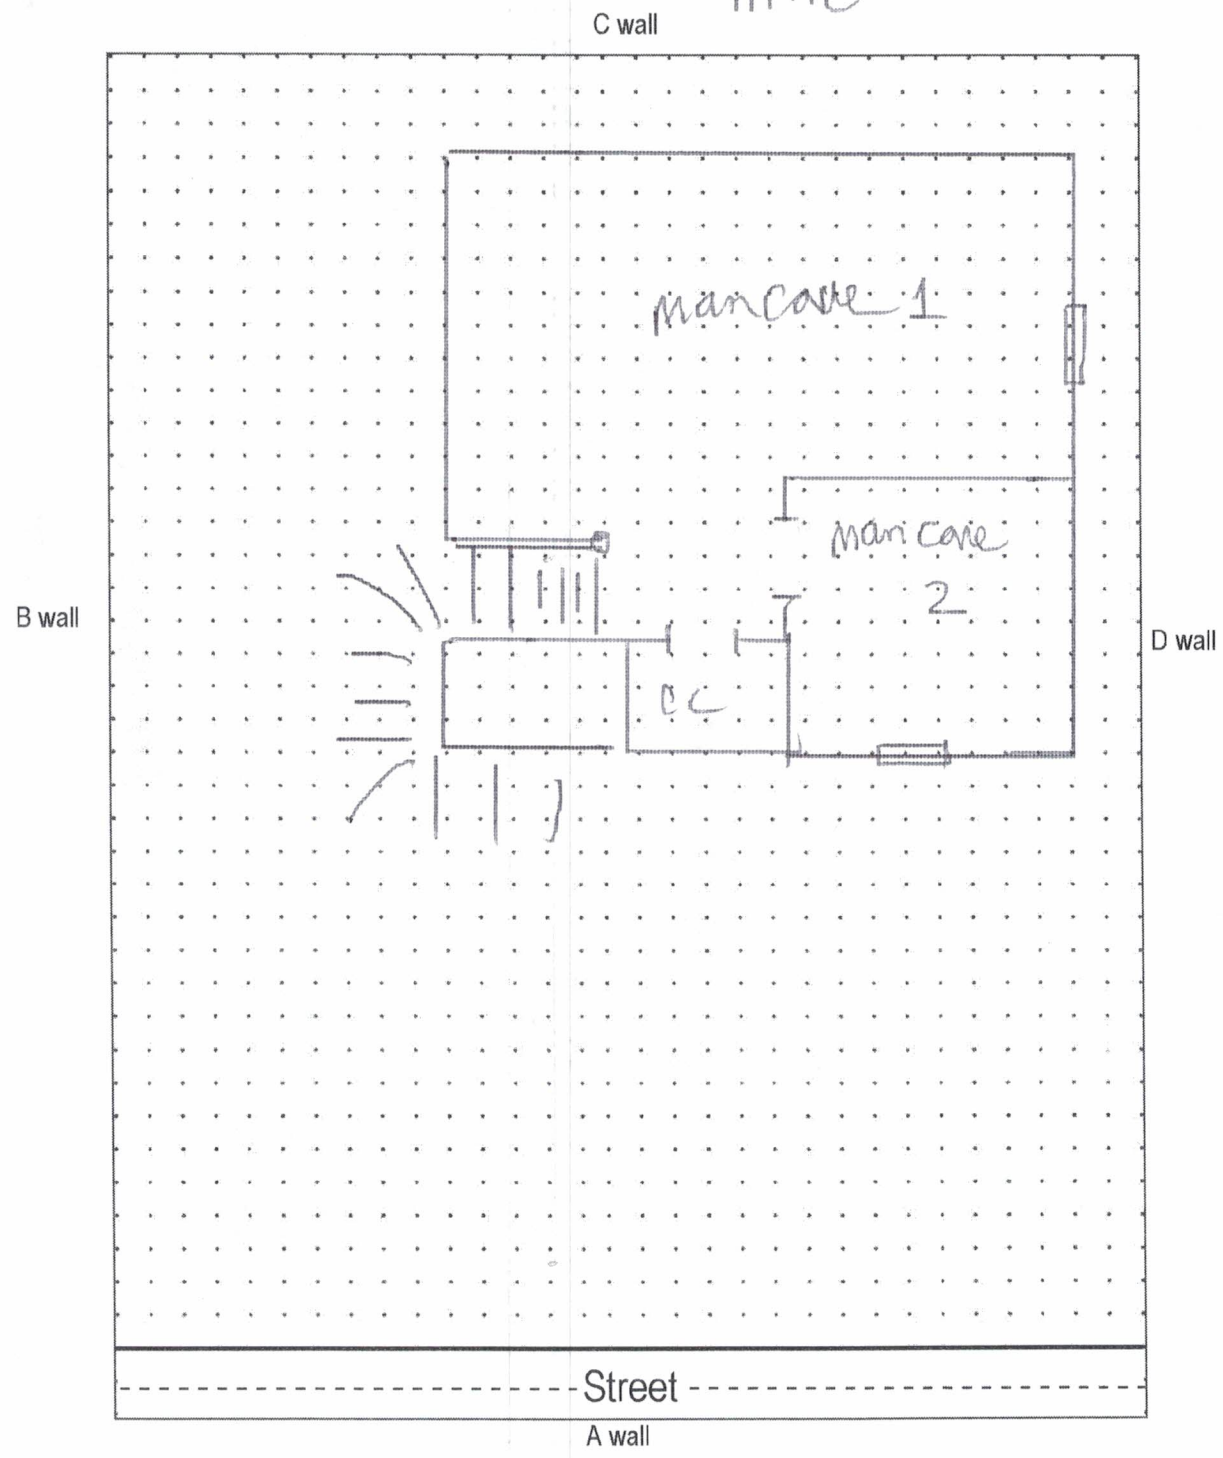

## Appendix B      Lead-Based Paint Evaluation Report

Company LEW Corporation  
 XRF Make Heuresis  
 Model Pb200i  
 Serial Num. 2822  
 Lead concentration units: mg/cm2  
 Total Readings: 194  
 Action Level 1  
 Mode Action Level  
 Analytic Mode Paint

All Readings

Job Id	Reading #	Concentration	Result	Calibration	RTA Present	Date	Time	User	Analytic Mode	Site Address	Area	Unit #	Room	Structure	Member	Substrate	Wall	Location
1090927	7748	0.9		TRUE	FALSE	1/9/2024	9:28 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ								
1090927	7749	1		TRUE	FALSE	1/9/2024	9:28 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ								
1090927	7750	1		TRUE	FALSE	1/9/2024	9:28 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ								
1090927	7751	0.1		TRUE	FALSE	1/9/2024	9:28 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ								
1090927	7752	0		TRUE	FALSE	1/9/2024	9:28 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ								
1090927	7753	0		TRUE	FALSE	1/9/2024	9:28 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ								
1090927	7754	0.1	Negative	FALSE	FALSE	1/9/2024	9:30 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Door	---	Metal	A	1	
1090927	7755	-0.1	Negative	FALSE	FALSE	1/9/2024	9:31 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Door	Casing	Wood	A	1	
1090927	7756	0.2	Negative	FALSE	FALSE	1/9/2024	9:31 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Window	Sash	Wood	A	1	
1090927	7757	0	Negative	FALSE	FALSE	1/9/2024	9:31 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Room	Wall	Drywall	A	1	
1090927	7758	0	Negative	FALSE	FALSE	1/9/2024	9:32 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Room	Wall	Drywall	C	1	
1090927	7759	0.1	Negative	FALSE	FALSE	1/9/2024	9:32 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Stair	Risers	Wood	B	1	
1090927	7760	0.1	Negative	FALSE	FALSE	1/9/2024	9:32 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Stair	Treads	Wood	B	1	
1090927	7761	0.1	Negative	FALSE	FALSE	1/9/2024	9:32 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Stair	Stringer	Wood	B	1	
1090927	7762	-0.1	Negative	FALSE	FALSE	1/9/2024	9:33 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Stair	Newel Post	Wood	B	1	
1090927	7763	0.1	Negative	FALSE	FALSE	1/9/2024	9:33 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Stair	Railing	Wood	B	1	
1090927	7764	0	Negative	FALSE	FALSE	1/9/2024	9:33 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Stair	Balusters	Wood	B	1	
1090927	7765	0.1	Negative	FALSE	FALSE	1/9/2024	9:34 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Room	Wall	Drywall	B	1	
1090927	7766	-0.1	Negative	FALSE	FALSE	1/9/2024	9:34 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Column	Shaft	Wood	D	1	
1090927	7767	-0.2	Negative	FALSE	FALSE	1/9/2024	9:34 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Column	Shaft	Wood	D	2	
1090927	7768	0.1	Negative	FALSE	FALSE	1/9/2024	9:34 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Column	Base	Wood	D	2	
1090927	7769	-0.2	Negative	FALSE	FALSE	1/9/2024	9:35 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Foyer	Room	Baseboard	Wood	D	1	
1090927	7770	0	Negative	FALSE	FALSE	1/9/2024	9:36 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Room	Wall	Drywall	A	1	
1090927	7771	-0.1	Negative	FALSE	FALSE	1/9/2024	9:36 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Room	Wall	Drywall	B	1	
1090927	7772	0.1	Negative	FALSE	FALSE	1/9/2024	9:36 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Room	Wall	Drywall	C	1	
1090927	7773	0	Negative	FALSE	FALSE	1/9/2024	9:37 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Room	Baseboard	Wood	C	1	
1090927	7774	-0.1	Negative	FALSE	FALSE	1/9/2024	9:37 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Door	Jamb	Wood	C	1	
1090927	7775	0	Negative	FALSE	FALSE	1/9/2024	9:37 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Door	Casing	Wood	C	1	
1090927	7776	0.1	Negative	FALSE	FALSE	1/9/2024	9:37 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Room	Wall	Drywall	D	1	
1090927	7777	0	Negative	FALSE	FALSE	1/9/2024	9:38 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Cabinets	Door	Wood	A	1	
1090927	7778	0.1	Negative	FALSE	FALSE	1/9/2024	9:38 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Cabinets	Frame	Wood	A	1	
1090927	7779	0	Negative	FALSE	FALSE	1/9/2024	9:38 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Window	Casing	Wood	B	1	
1090927	7780	-0.1	Negative	FALSE	FALSE	1/9/2024	9:39 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Kitchen	Window	Jamb	Wood	B	1	
1090927	7781	0	Negative	FALSE	FALSE	1/9/2024	9:39 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Rear Entry	Room	Wall	Drywall	A	1	
1090927	7782	0.2	Negative	FALSE	FALSE	1/9/2024	9:39 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Rear Entry	Room	Wall	Drywall	B	1	
1090927	7783	0.1	Negative	FALSE	FALSE	1/9/2024	9:39 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Rear Entry	Room	Wall	Drywall	C	1	
1090927	7784	0.1	Negative	FALSE	FALSE	1/9/2024	9:40 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Rear Entry	Room	Wall	Drywall	D	1	
1090927	7785	0.1	Negative	FALSE	FALSE	1/9/2024	9:40 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Rear Entry	Room	Baseboard	Wood	B	1	
1090927	7786	0	Negative	FALSE	FALSE	1/9/2024	9:40 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Rear Entry	Door	---	Metal	C	1	
1090927	7787	0.1	Negative	FALSE	FALSE	1/9/2024	9:40 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Rear Entry	Door	Casing	Wood	C	1	
1090927	7788	-0.4	Negative	FALSE	FALSE	1/9/2024	9:41 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Rear Entry	Door	Jamb	Wood	C	1	
1090927	7789	0.1	Negative	FALSE	FALSE	1/9/2024	9:41 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	Rear Entry	Radiator	Baseboard	Metal	D	1	
1090927	7790	0.2	Negative	FALSE	FALSE	1/9/2024	9:42 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	laundry room	Radiator	Baseboard	Metal	C	1	
1090927	7791	0	Negative	FALSE	FALSE	1/9/2024	9:42 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	laundry room	Room	Wall	Drywall	A	1	
1090927	7792	0	Negative	FALSE	FALSE	1/9/2024	9:42 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	laundry room	Room	Wall	Drywall	B	1	
1090927	7793	0	Negative	FALSE	FALSE	1/9/2024	9:43 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	laundry room	Room	Wall	Drywall	C	1	
1090927	7794	0	Negative	FALSE	FALSE	1/9/2024	9:43 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit	laundry room	Window	Jamb	Wood	C	1	



Job Id	Reading #	Concentration	Result	Calibration	RTA Present	Date	Time	User	Analytic Mode	Site Address	Area	Unit #	Room	Structure	Member	Substrate	Wall	Location
1090927	7795	0	Negative	FALSE	FALSE	1/9/2024	9:43 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		laundry room	Window	Casing	Wood	C	1
1090927	7796	0	Negative	FALSE	FALSE	1/9/2024	9:43 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		laundry room	Room	Baseboard	Wood	D	1
1090927	7797	0.1	Negative	FALSE	FALSE	1/9/2024	9:44 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		laundry room	Room	Wall	Drywall	D	1
1090927	7798	-0.3	Negative	FALSE	FALSE	1/9/2024	9:44 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		laundry room	Door	Jamb	Wood	A	1
1090927	7799	-0.1	Negative	FALSE	FALSE	1/9/2024	9:44 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		laundry room	Door	Casing	Wood	A	1
1090927	7800	-0.2	Negative	FALSE	FALSE	1/9/2024	9:45 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Door	Casing	Wood	B	1
1090927	7801	-0.1	Negative	FALSE	FALSE	1/9/2024	9:45 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Door	Jamb	Wood	B	1
1090927	7802	0.1	Negative	FALSE	FALSE	1/9/2024	9:45 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Door	---	Wood	B	1
1090927	7803	-0.2	Negative	FALSE	FALSE	1/9/2024	9:45 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Window	Jamb	Wood	C	1
1090927	7804	0.1	Negative	FALSE	FALSE	1/9/2024	9:45 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Window	Casing	Wood	C	1
1090927	7805	0	Negative	FALSE	FALSE	1/9/2024	9:46 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Radiator	Baseboard	Metal	C	1
1090927	7806	-0.1	Negative	FALSE	FALSE	1/9/2024	9:46 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Room	Baseboard	Wood	D	1
1090927	7807	0	Negative	FALSE	FALSE	1/9/2024	9:46 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Room	Wall	Drywall	D	1
1090927	7808	0.1	Negative	FALSE	FALSE	1/9/2024	9:46 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Room	Wall	Drywall	A	1
1090927	7809	0.2	Negative	FALSE	FALSE	1/9/2024	9:47 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Room	Wall	Drywall	B	1
1090927	7810	0.1	Negative	FALSE	FALSE	1/9/2024	9:47 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Room	Wall	Drywall	B	2
1090927	7811	0	Negative	FALSE	FALSE	1/9/2024	9:47 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Room	Wall	Drywall	C	1
1090927	7812	0.1	Negative	FALSE	FALSE	1/9/2024	9:48 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Dining Room	Room	Wall	Drywall	C	1
1090927	7813	-0.1	Negative	FALSE	FALSE	1/9/2024	9:48 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Dining Room	Room	Baseboard	Wood	C	1
1090927	7814	0	Negative	FALSE	FALSE	1/9/2024	9:48 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Dining Room	Room	Wall	Drywall	D	1
1090927	7815	-0.2	Negative	FALSE	FALSE	1/9/2024	9:48 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Dining Room	Room	Wall	Drywall	A	1
1090927	7816	0.1	Negative	FALSE	FALSE	1/9/2024	9:49 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Dining Room	Radiator	Baseboard	Metal	D	1
1090927	7817	0	Negative	FALSE	FALSE	1/9/2024	9:49 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Dining Room	Room	Wall	Drywall	B	1
1090927	7818	0	Negative	FALSE	FALSE	1/9/2024	9:49 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Dining Room	Room	Baseboard	Wood	B	1
1090927	7819	0.2	Negative	FALSE	FALSE	1/9/2024	9:49 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Living Room	Room	Baseboard	Wood	C	1
1090927	7820	0	Negative	FALSE	FALSE	1/9/2024	9:50 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Living Room	Room	Wall	Drywall	C	1
1090927	7821	0.1	Negative	FALSE	FALSE	1/9/2024	9:50 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Living Room	Room	Wall	Drywall	D	1
1090927	7822	0	Negative	FALSE	FALSE	1/9/2024	9:50 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Living Room	Room	Wall	Drywall	B	1
1090927	7823	-0.1	Negative	FALSE	FALSE	1/9/2024	9:50 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Living Room	Room	Wall	Drywall	A	1
1090927	7824	-0.1	Negative	FALSE	FALSE	1/9/2024	9:51 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Living Room	Window	Jamb	Wood	D	1
1090927	7825	-0.2	Negative	FALSE	FALSE	1/9/2024	9:51 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Living Room	Window	Casing	Wood	D	1
1090927	7826	0	Negative	FALSE	FALSE	1/9/2024	9:52 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Foyer	Room	Ceiling	Drywall	D	1
1090927	7827	0	Negative	FALSE	FALSE	1/9/2024	9:52 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Kitchen	Room	Ceiling	Drywall	D	1
1090927	7828	-0.1	Negative	FALSE	FALSE	1/9/2024	9:53 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Rear Entry	Room	Ceiling	Drywall	D	1
1090927	7829	0	Negative	FALSE	FALSE	1/9/2024	9:53 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		laundry room	Room	Ceiling	Drywall	D	1
1090927	7830	0.2	Negative	FALSE	FALSE	1/9/2024	9:53 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 1	Room	Ceiling	Drywall	D	1
1090927	7831	-0.1	Negative	FALSE	FALSE	1/9/2024	9:54 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Dining Room	Room	Ceiling	Drywall	D	1
1090927	7832	0	Negative	FALSE	FALSE	1/9/2024	9:54 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Living Room	Room	Ceiling	Drywall	D	1
1090927	7833	0	Negative	FALSE	FALSE	1/9/2024	9:55 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Room	Ceiling	Drywall	B	1
1090927	7834	0.1	Negative	FALSE	FALSE	1/9/2024	9:55 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Room	Wall	Drywall	C	1
1090927	7835	0.1	Negative	FALSE	FALSE	1/9/2024	9:56 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Room	Wall	Drywall	A	1
1090927	7836	-0.1	Negative	FALSE	FALSE	1/9/2024	9:56 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Room	Wall	Drywall	B	1
1090927	7837	0.1	Negative	FALSE	FALSE	1/9/2024	9:56 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Room	Wall	Drywall	D	1
1090927	7838	-0.1	Negative	FALSE	FALSE	1/9/2024	9:56 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Stair	Risers	Wood	D	1
1090927	7839	-0.1	Negative	FALSE	FALSE	1/9/2024	9:57 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Stair	Treads	Wood	D	1
1090927	7840	-0.3	Negative	FALSE	FALSE	1/9/2024	9:57 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Stair	Stringer	Wood	D	1
1090927	7841	-0.1	Negative	FALSE	FALSE	1/9/2024	9:57 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Room	Baseboard	Wood	C	1
1090927	7842	0.1	Negative	FALSE	FALSE	1/9/2024	9:57 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Door	---	Metal	B	1
1090927	7843	0.1	Negative	FALSE	FALSE	1/9/2024	9:58 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Door	Jamb	Metal	B	1
1090927	7844	-0.2	Negative	FALSE	FALSE	1/9/2024	9:58 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Side Entry	Door	Casing	Metal	B	1
1090927	7845	0	Negative	FALSE	FALSE	1/9/2024	9:59 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		2nd Floor Hallway	Door	Casing	Wood	A	1
1090927	7846	-0.2	Negative	FALSE	FALSE	1/9/2024	9:59 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		2nd Floor Hallway	Door	Jamb	Wood	A	1
1090927	7847	0.1	Negative	FALSE	FALSE	1/9/2024	9:59 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		2nd Floor Hallway	Door	---	Wood	A	1
1090927	7848	0	Negative	FALSE	FALSE	1/9/2024	10:00 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		2nd Floor Hallway	Room	Wall	Drywall	A	1
1090927	7849	0.1	Negative	FALSE	FALSE	1/9/2024	10:00 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		2nd Floor Hallway	Room	Wall	Drywall	C	1
1090927	7850	0.1	Negative	FALSE	FALSE	1/9/2024	10:00 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		2nd Floor Hallway	Room	Wall	Drywall	D	1
1090927	7851	0.1	Negative	FALSE	FALSE	1/9/2024	10:00 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		2nd Floor Hallway	Room	Wall	Drywall	C	2

Job Id	Reading #	Concentration	Result	Calibration	RTA Present	Date	Time	User	Analytic Mode	Site Address	Area	Unit #	Room	Structure	Member	Substrate	Wall	Location
1090927	7852	-0.1	Negative	FALSE	FALSE	1/9/2024	10:01 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		2nd Floor Hallway	Room	Baseboard	Wood	C	2
1090927	7853	0	Negative	FALSE	FALSE	1/9/2024	10:01 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Room	Baseboard	Wood	A	2
1090927	7854	-0.1	Negative	FALSE	FALSE	1/9/2024	10:01 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Room	Wall	Drywall	A	2
1090927	7855	0	Negative	FALSE	FALSE	1/9/2024	10:02 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Room	Wall	Drywall	B	1
1090927	7856	0	Negative	FALSE	FALSE	1/9/2024	10:02 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Room	Wall	Drywall	C	1
1090927	7857	-0.1	Negative	FALSE	FALSE	1/9/2024	10:02 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Room	Wall	Drywall	D	1
1090927	7858	0.1	Negative	FALSE	FALSE	1/9/2024	10:02 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Window	Jamb	Wood	C	1
1090927	7859	-0.2	Negative	FALSE	FALSE	1/9/2024	10:03 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Window	Casing	Wood	C	1
1090927	7860	0.1	Negative	FALSE	FALSE	1/9/2024	10:03 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Radiator	Baseboard	Metal	C	1
1090927	7861	0	Negative	FALSE	FALSE	1/9/2024	10:03 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Cabinets	Door	Wood	B	1
1090927	7862	0	Negative	FALSE	FALSE	1/9/2024	10:03 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bathroom 2	Cabinets	Frame	Wood	B	1
1090927	7863	0	Negative	FALSE	FALSE	1/9/2024	10:04 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Door	---	Wood	D	1
1090927	7864	0	Negative	FALSE	FALSE	1/9/2024	10:04 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Door	Jamb	Wood	D	1
1090927	7865	0	Negative	FALSE	FALSE	1/9/2024	10:04 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Door	Casing	Wood	D	1
1090927	7866	-0.1	Negative	FALSE	FALSE	1/9/2024	10:05 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Room	Wall	Drywall	D	1
1090927	7867	-0.1	Negative	FALSE	FALSE	1/9/2024	10:05 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Room	Wall	Drywall	A	1
1090927	7868	-0.1	Negative	FALSE	FALSE	1/9/2024	10:05 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Room	Wall	Drywall	B	1
1090927	7869	0	Negative	FALSE	FALSE	1/9/2024	10:05 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Room	Wall	Drywall	C	1
1090927	7870	0.2	Negative	FALSE	FALSE	1/9/2024	10:06 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Radiator	Baseboard	Metal	C	1
1090927	7871	0	Negative	FALSE	FALSE	1/9/2024	10:06 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Window	Jamb	Wood	C	1
1090927	7872	-0.1	Negative	FALSE	FALSE	1/9/2024	10:06 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Window	Casing	Wood	C	1
1090927	7873	0.1	Negative	FALSE	FALSE	1/9/2024	10:07 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Closet	Door	Wood	C	1
1090927	7874	0	Negative	FALSE	FALSE	1/9/2024	10:07 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Closet	Door Jamb	Wood	C	1
1090927	7875	0.1	Negative	FALSE	FALSE	1/9/2024	10:07 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Closet	Door Casing	Wood	C	1
1090927	7876	-0.1	Negative	FALSE	FALSE	1/9/2024	10:08 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Closet	Wall	Drywall	C	1
1090927	7877	-0.1	Negative	FALSE	FALSE	1/9/2024	10:08 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 1	Room	Baseboard	Wood	A	1
1090927	7878	0.1	Negative	FALSE	FALSE	1/9/2024	10:08 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Door	---	Wood	B	1
1090927	7879	-0.1	Negative	FALSE	FALSE	1/9/2024	10:09 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Door	Jamb	Wood	B	1
1090927	7880	0	Negative	FALSE	FALSE	1/9/2024	10:09 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Door	Casing	Wood	B	1
1090927	7881	0.1	Negative	FALSE	FALSE	1/9/2024	10:09 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Closet	Door Jamb	Wood	A	1
1090927	7882	-0.2	Negative	FALSE	FALSE	1/9/2024	10:09 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Closet	Door Casing	Wood	A	1
1090927	7883	-0.1	Negative	FALSE	FALSE	1/9/2024	10:10 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Closet	Wall	Drywall	A	1
1090927	7884	-0.1	Negative	FALSE	FALSE	1/9/2024	10:10 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Room	Wall	Drywall	A	1
1090927	7885	0	Negative	FALSE	FALSE	1/9/2024	10:10 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Room	Wall	Drywall	B	1
1090927	7886	0.2	Negative	FALSE	FALSE	1/9/2024	10:10 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Room	Wall	Drywall	C	1
1090927	7887	0.1	Negative	FALSE	FALSE	1/9/2024	10:11 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Room	Wall	Drywall	D	1
1090927	7888	0	Negative	FALSE	FALSE	1/9/2024	10:11 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Window	Jamb	Wood	D	1
1090927	7889	-0.1	Negative	FALSE	FALSE	1/9/2024	10:11 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Window	Casing	Wood	D	1
1090927	7890	0	Negative	FALSE	FALSE	1/9/2024	10:12 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Radiator	Baseboard	Metal	C	1
1090927	7891	-0.1	Negative	FALSE	FALSE	1/9/2024	10:12 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 2	Room	Baseboard	Wood	C	1
1090927	7892	0	Negative	FALSE	FALSE	1/9/2024	10:13 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Door	---	Wood	B	1
1090927	7893	0.1	Negative	FALSE	FALSE	1/9/2024	10:13 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Door	Jamb	Wood	B	1
1090927	7894	0	Negative	FALSE	FALSE	1/9/2024	10:13 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Door	Casing	Wood	B	1
1090927	7895	0.1	Negative	FALSE	FALSE	1/9/2024	10:13 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Room	Wall	Drywall	B	1
1090927	7896	-0.1	Negative	FALSE	FALSE	1/9/2024	10:14 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Room	Wall	Drywall	C	1
1090927	7897	0	Negative	FALSE	FALSE	1/9/2024	10:14 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Room	Wall	Drywall	D	1
1090927	7898	-0.1	Negative	FALSE	FALSE	1/9/2024	10:14 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Room	Wall	Drywall	A	1
1090927	7899	0	Negative	FALSE	FALSE	1/9/2024	10:14 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Radiator	Baseboard	Metal	A	1
1090927	7900	-0.1	Negative	FALSE	FALSE	1/9/2024	10:15 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Window	Jamb	Wood	A	1
1090927	7901	-0.1	Negative	FALSE	FALSE	1/9/2024	10:15 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Window	Casing	Wood	A	1
1090927	7902	0.1	Negative	FALSE	FALSE	1/9/2024	10:15 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Closet	Door	Wood	C	1
1090927	7903	0	Negative	FALSE	FALSE	1/9/2024	10:16 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Closet	Door Jamb	Wood	C	1
1090927	7904	-0.1	Negative	FALSE	FALSE	1/9/2024	10:16 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Closet	Door Casing	Wood	C	1
1090927	7905	0	Negative	FALSE	FALSE	1/9/2024	10:16 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 3	Closet	Wall	Drywall	C	1
1090927	7906	0.1	Negative	FALSE	FALSE	1/9/2024	10:18 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 4	Door	---	Wood	C	1
1090927	7907	0	Negative	FALSE	FALSE	1/9/2024	10:18 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 4	Door	Jamb	Wood	C	1
1090927	7908	0	Negative	FALSE	FALSE	1/9/2024	10:18 AM	Alex Salvador	Paint	1210 11th Avenue Neptune NJ	Unit		Bedroom 4	Door	Casing	Wood	C	1



Company LEW Corporation  
XRF Make Heuresis  
Model Pb200i  
Serial Num. 2822

Lead concentration units: mg/cm2

Total Readings: 194 Total Positives 0

Action Level 1

Mode Action Level

Analytic Mode Paint

### Actionables

Job Id	Reading #	Concentration	Result	Calibration	RTA Present	Date	Time	User	Analytic Mode	Site Address	Area	Unit #	Room	Structure	Member	Substrate	Wall	Location
No Actionables																		

## Appendix C

## Photographs (if applicable)

LEW Environmental Services, LLC. is not responsible for the quality of the pictures, nor the clarity, content or the detail.

Appendix D Lab Support Documents (if applicable)

# Lead - FREE CERTIFICATE

## **LEAD - FREE (INTERIOR) ONLY**

It is hereby certified that a lead-based paint inspection, has been performed, and the results of this inspection indicate that no lead in the amount greater than or equal to 1.0 mg/cm<sup>2</sup> or greater than 0.5 % by weight in paint, was found on any building component using the protocols outlined in **N.J.A.C. 5:17-3.2(c)**. Therefore, the dwelling(s) identified below qualify for the following exemption.

- N.J.A.C. 5:10-1.12(h)4** (Additional Lead Paint Fee) BHI Registration Number: N/A
- N.J.A.C. 5:10-6.6** (Lead-Safe Maintenance)
- N.J.A.C. 5:27-4.10(a)1 OR N.J.A.C. 5:15-4.2(c)** (Rooming & Boarding **OR** Emergency Shelters) Facility ID:
- N.J.A.C. 5:28-2.1(a)** State Housing Code
- CHILD OCCUPIED FACILITY (Daycare Centers, Preschools, etc.)** **PURSUANT TO N.J.A.C. 5:17**

Site Address: 1210 11th Ave, Neptune, NJ, 07753 County: Monmouth Block: 517 Lot: 9

Applicable Units or Common Areas: House Interior

Name of Inspector / Risk Assessor: Alex Salvador NJDOH ID #: 022779

Name of Evaluation Contractor: LEW Environmental Services, LLC NJDCA CERT. #: 00015

Address of Evaluation Contractor: 181 US Hwy 46, Mine Hill, NJ 07803 Phone #: (908) 654-8068

Date(s) of Inspection: 01 / 09 / 2024

Date Certificate Issued: 01 / 09 / 2024 Signature of Inspector / Risk Assessor: Alex Salvador

**THIS CERTIFICATE SHOULD BE KEPT BY THE OWNER AND TRANSFERRED TO ALL FUTURE OWNERS FOR LIFE OF STRUCTURE**